

**On-wall hygrostats and humidity and temperature sensors ( $\pm 2.0\%$ ), electronic, two-step, with multi-range switching and continuous / switching output**

Electronic on-wall hygrometer and/or on-wall thermostat HYGRASREG® AHT-30 with a continuous and two switching outputs, adjustable switching thresholds and display for indicating ACTUAL humidity and/or ACTUAL temperature (accuracy class  $\pm 2.0\%$  r.H.). The setpoints can be allocated to the relative humidity and/or to the temperature.


It is suitable for regulating and monitoring relative humidity (humidifying and dehumidifying) and/or the temperature (heating and cooling), e.g. in laboratories, production facilities, climatic test cabinets, indoor swimming pools, greenhouses, etc., to control humidifying and dehumidifying equipment or heating system control. The measuring transducers are designed for exact humidity/temperature measurement. The AHT-30 uses a digital, long-term stable sensor as a measuring element. It is used in dust-free, unpolluted, non-aggressive air.

## TECHNICAL DATA

Power supply:	24 V AC / DC ( $\pm 20\%$ )
Power consumption:	< 1,5 VA / 24 V DC, < 3,5 VA / 24 V AC
Sensor:	<b>digital humidity sensor with integrated temperature sensor,</b> low hysteresis, high long-term stability
Sensor protection:	<b>plastic sinter filter, Ø 16 mm, L = 35 mm, exchangeable</b> (optional <b>metal</b> sinter filter, Ø 16 mm, L = 32 mm)
Setting range:	5...95 % r.H. (humidity) <b>Multi-range switching with</b> <b>4 switchable measuring ranges</b> (see table) -35...+35 °C; -35...+75 °C; 0...+50 °C; 0...+80 °C (temperature) (Switch steps 1 and 2 are separately adjustable)
Operating difference:	<b>Mode 1:</b> both switch steps are freely adjustable (rel. humidity) <b>Mode 2:</b> 5 % between both switch steps (rel. humidity) <b>Mode 3:</b> both switch steps freely adjustable (temperature) <b>Mode 4:</b> switch step 1 (temperature), switch step 2 (rel. humidity) (adjustable via DiP switches)
Output:	potential-free changeover contacts (2x changeover contact 24 V, 1A ohmic load, separately adjustable, 2x 0-10V for U variant or 4...20mA for I variant)
Deviation, humidity:	typically <b><math>\pm 2.0\%</math></b> (20...80 % r.H.) at +25 °C, otherwise $\pm 3.0\%$
Deviation, temperature:	<b><math>\pm 0.2\text{K}</math></b> at +25 °C
Ambient temperature:	storage -35...+85 °C; operation -30...+75 °C, non-precipitating
Long-term stability:	$\pm 1\%$ per year
Enclosure:	plastic, UV-stabilised, material polyamide, 30 % glass-globe reinforced, with quick-locking screws (slotted / Phillips head combination), colour traffic white (similar to RAL 9016), enclosure cover for display is transparent!
Enclosure dimensions:	126 x 90 x 50 mm (Tyr 2)
Cable gland:	M 16 x 1.5; including strain relief, exchangeable, max. inner diameter 10.4 mm
Protective tube:	<b>stainless steel</b> , Ø 16 mm, NL = 55 mm (see dimensional drawing)
Protection class:	III (according to EN 60 730)
Protection type:	IP 65 (according to EN 60 529) enclosure only!
Electrical connection:	0.14 - 1.5 mm <sup>2</sup> , via terminal screws
Standards:	CE conformity, EMC directive 2014 / 30 / EU
Display:	three-line <b>display with illumination</b> , cutout approx. 70 x 40 mm (W x H), for displaying ACTUAL humidity and/or ACTUAL temperature or for setpoint adjustment
<b>FUNCTION</b>	
Humidifying/heating:	<b>1st step:</b> wire contacts 11 - 12. If actual humidity falls more than 3% r.H./1 K (hysteresis) below switching threshold S1, the changeover contact switches to 11 - 12. <b>2nd step:</b> wire contacts 21 - 22. If actual humidity falls more than 3% r.H./1 K (hysteresis) below switching threshold S2, the changeover contact switches to 21 - 22. Terminal 2: output relative humidity / terminal 3: output temperature
Dehumidifying/cooling:	<b>1st step:</b> wire contacts 11 - 13. When actual humidity exceeds switching threshold S1, the changeover contact switches to 11 - 13. <b>2nd step:</b> wire contacts 21 - 23. When actual humidity exceeds switching threshold S2, the changeover contact switches to 21 - 23. Terminal 2: output relative humidity / terminal 3: output temperature

On-wall hygrostats and  
humidity and temperature sensors ( $\pm 2.0\%$ ),  
electronic, two-step, with multi-range switching  
and continuous /switching output

Dimensional drawing

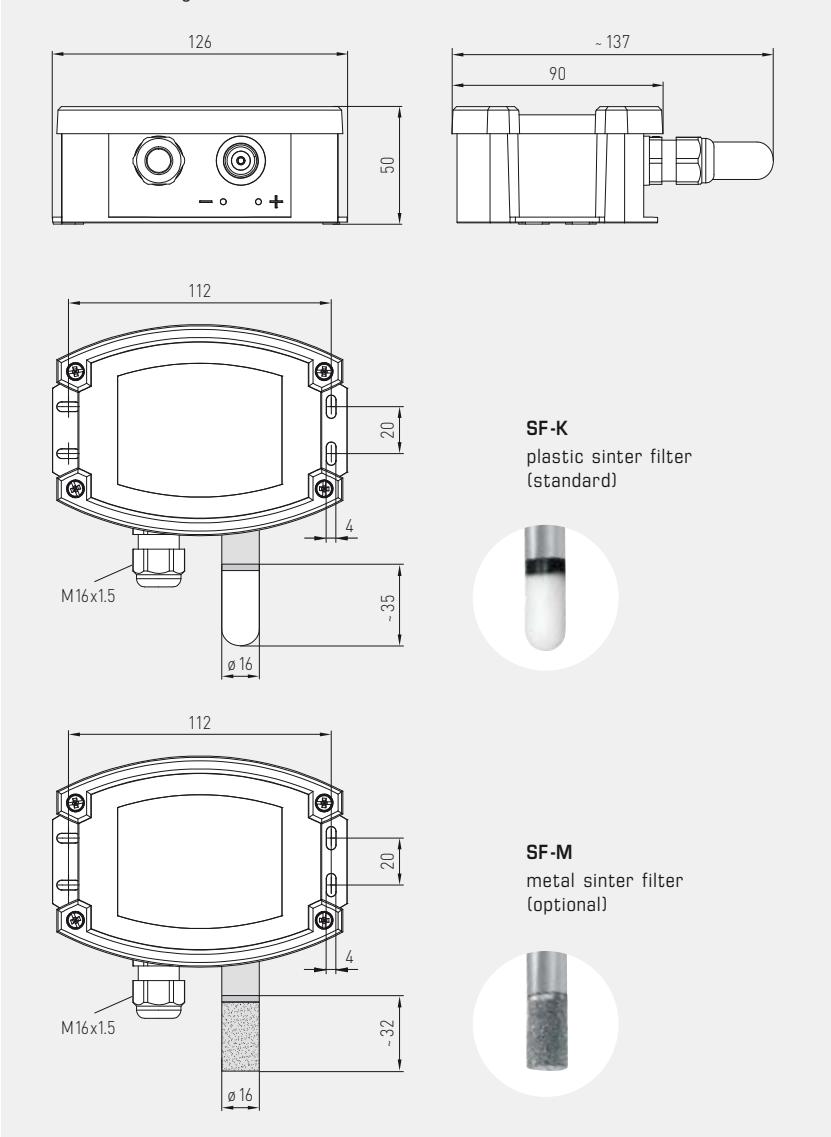

#### WS-03

Weather and sun protection hood  
(optional)



AHT-30

with display and  
plastic sinter filter  
(standard)



AHT-30

with display and  
metal sinter filter  
(optional)



#### Display readout

The **1st line** of the display shows  
the **ACTUAL humidity** in % r.H. and  
the **ACTUAL temperature** in °C.


The displays showing the **ACTUAL values**  
alternate in a 3-second rhythm.

The resolution is 1/10 % r.H. or 1/10 °C.


The **3rd line** shows information about the  
**switching status of relay 1 and 2** (as circuits)  
on the left, and on the right for the **switching  
values of relay 1 and 2** in % r.H. or °C  
(adjustable via the corresponding set  
potentiometer). The reference to respective  
measured value (relative humidity or  
temperature) is determined by the mode  
selected.

For improved legibility,  
backlighting is provided.


On-wall hygrostats and  
humidity and temperature sensors ( $\pm 2.0\%$ ),  
electronic, two-step, with multi-range switching  
and continuous /switching output

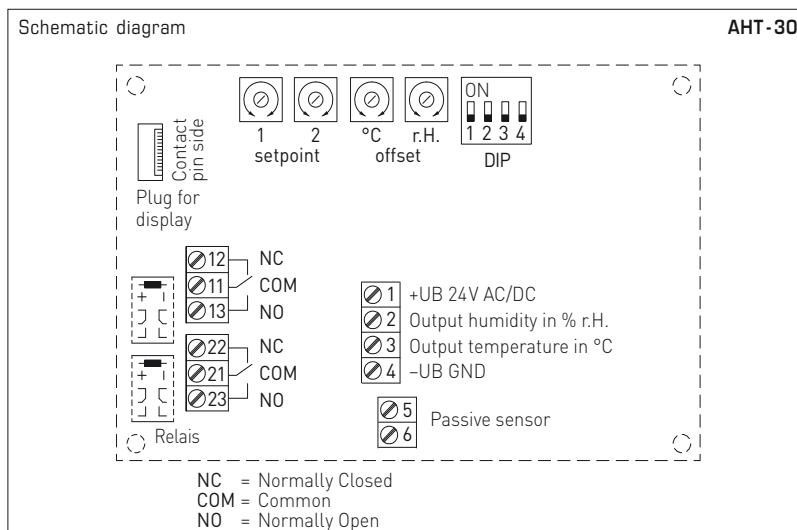

<b>DIP switches</b>		<b>AHT-30</b>	
<b>Function mode</b>	<b>DIP 1</b>	<b>DIP 2</b>	
<b>Mode 1</b> (2x 5...95 % r.H.)	OFF	OFF	
<b>Mode 2</b> (5...95 % r.H. + 5 % r.H.)	ON	OFF	
<b>Mode 3</b> (2x -35...+80 °C)	OFF	ON	
<b>Mode 4</b> (5...95 % r.H. / -35...+80 °C)	ON	ON	
<b>Temperature range</b>	<b>DIP 3</b>	<b>DIP 4</b>	
-35...+35 °C	OFF	OFF	
0...+80 °C	ON	OFF	
0...+50 °C	OFF	ON	
-35...+75 °C	ON	ON	

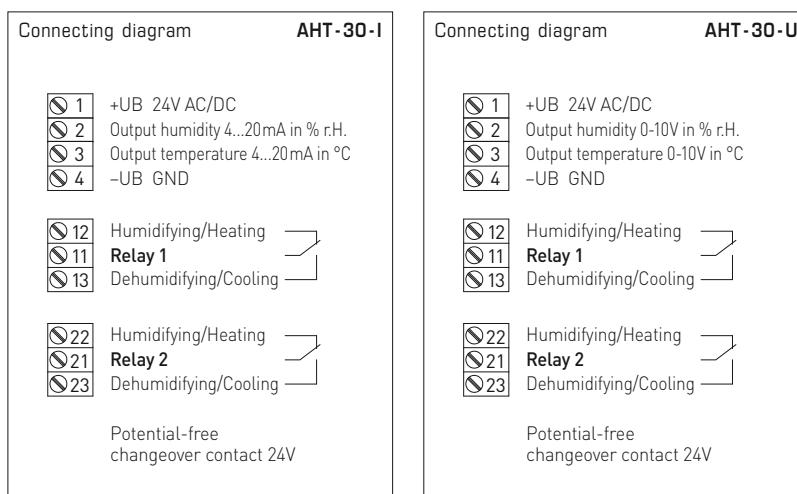

<b>Supply</b>	<b>AC</b>	<b>DC</b>
→ 1	24 V~	24 V DC
→ 4	0 V	GND
12 (A1) →	<b>Relay 1</b> Breaker contact	
11 (W1) →	<b>Relay 1</b> Changeover contact	
13 (B1) →	<b>Relay 1</b> Normally open contact	
22 (A2) →	<b>Relay 2</b> Breaker contact	
21 (W2) →	<b>Relay 2</b> Changeover contact	
23 (B2) →	<b>Relay 2</b> Normally open contact	

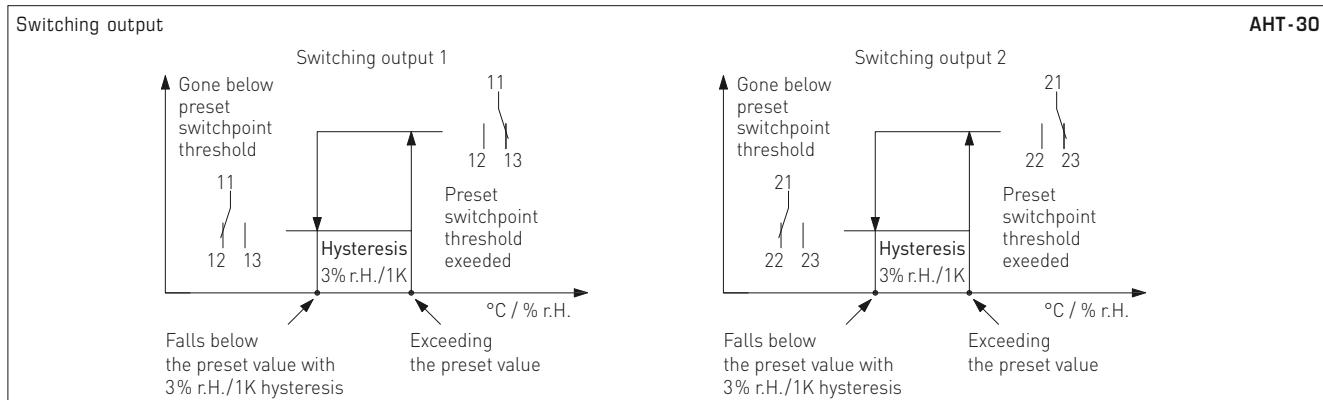

**Mode 1:** Independent switchpoints for both relay outputs can be defined in the range of 5...95 % r.H. by the control knobs (setpoint 1 for relay 1, setpoint 2 for relay 2, see schematic diagram). When the respective switchpoint is exceeded, the corresponding relay switches over (changeover contact 1 switches from position 2 to position 3). When the pre-set switchpoint is undershot again by more than 3% r.H. (hysteresis), the respective switching output switches back to the initial position (changeover contact 1 switches from position 3 to position 2).

**Mode 2:** In Mode 2, only control knob setpoint 1 is active (setpoint 2 without function)! The switchpoint for the first relay is defined in the range of 5...95 % r.H. by the control knob setpoint 1 (see schematic diagram). The switchpoint for the second relay output is invariably defined in mode 2 as "Switchpoint 1 + 5 % r.H.". Hysteresis of 3% r.H. is also predefined for each switching output in mode 2.

**Mode 3:** Independent switchpoints within the temperature range (selectable via DIP switches) for both relay outputs can be defined by the control knobs (setpoint 1 for relay 1, setpoint 2 for relay 2). If the respective switchpoint is exceeded, the corresponding relay switches over. If the pre-set threshold value is undershot again by 1 K (hysteresis), the respective switching output switches back to the initial position. The thresholds of the setting range (temperature) are 5 °C above the minimum or below the maximum range value respectively.

**Mode 4:** In mode 4, the control knob is allocated to setpoint 1 of the temperature, while control knob is allocated to setpoint 2 of the relative humidity. The switchpoints can be set within the temperature range (selectable via DIP switches) or from 5...95 % r.H. (humidity). The thresholds of the setting range (temperature) are 5 °C above the minimum or below the maximum range value respectively.

